


TECHNICAL DATA | SPRING CHECK VALVE - TRUE UNION | BSP THREADED

Standards: Compatible with AS/NZS 1477 Pressure Pipe Applications
 Size Range: 15mm - 100mm
 Fitting Details: BSP Threaded

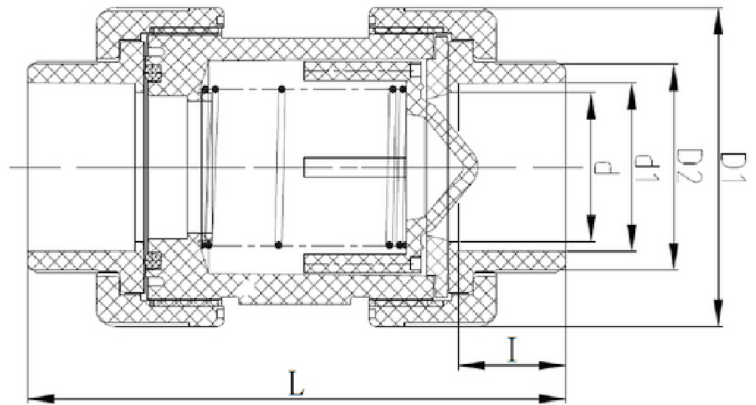

Size mm	Thread Size (d1) inch	d mm	D1 mm	D2 mm	I mm	L mm	Code
15	1/2"	21.34	48	27.4	17	87.2	STCVTDU015
20	3/4"	26.67	68	36.2	19.7	114.53	STCVTDU020
25	1"	33.4	68	42	23	129.5	STCVTDU025
32	1 1/4"	42.16	95	52.6	27	151.1	STCVTDU032
40	1 1/2"	48.26	92.8	61.4	32	160.3	STCVTDU40
50	2"	60.33	114.8	77.6	38	193.2	STCVTDU50
65	2 1/2"	73	148	89.4	45	231.4	STCVTDU65
80	3"	88.9	179	108.5	58	270	STCVTDU80
100	4"	114.3	179	132.5	63.5	281.8	STCVTDU100

Note:

Installation should always be performed by a licensed operator. It is the responsibility of the installer to check that both the pipe(s) and fitting(s) that are installed are compatible, only compatible materials should be joined together. It is the responsibility of the licensed installer to check the PN and PSI ratings marked on the fitting(s) and ensure that the pipe is compatible. Correct installation procedures should always be followed.

The drawings, materials and specifications outlined are subject to change without notice due to the continuous improvements and development of our product range.

FUSION QLD PTY LTD

ABN: 42 987 067 369
 13 Vision Court, Noosaville, QLD, 4566
 42-44 South Link, Dandenong, VIC, 3175

CONTACT


T: +61 7 5474 3000 (Qld)
 T: +61 3 9037 4755 (Vic)
 E: sales@fusionqld.com.au
 W: fusionqld.com.au

TECHNICAL DATA | SPRING CHECK VALVE - TRUE UNION | SOLVENT WELD

Standards: Compatible with AS/NZS 1477 Pressure Pipe Applications

Size Range: 15mm - 100mm

Fitting Details: Solvent Weld

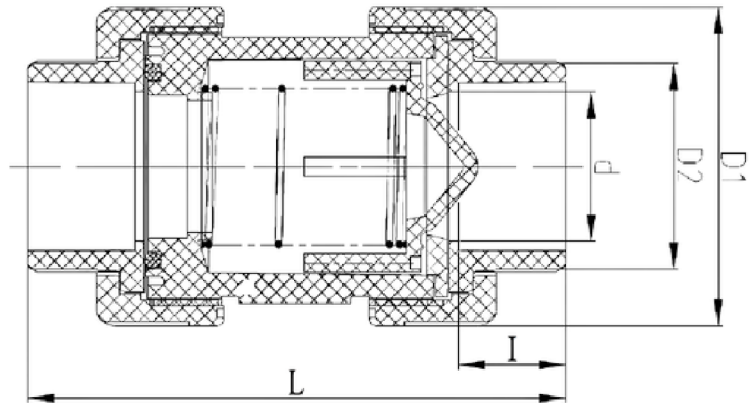

Size mm	d mm	D1 mm	D2 mm	I mm	L mm	Code
15	21.34	48	27.4	17	87.2	STCVSDU015
20	26.67	68	36.2	19.7	114.53	STCVSDU020
25	33.4	68	42	23	129.5	STCVSDU025
32	42.16	95	52.6	27	151.1	STCVSDU032
40	48.26	92.8	61.4	32	160.3	STCVSDU40
50	60.33	114.8	77.6	38	193.2	STCVSDU50
65	73	148	89.4	45	231.4	STCVSDU65
80	88.9	179	108.5	58	270	STCVSDU80
100	114.3	179	132.5	63.5	281.8	STCVSDU100

Note:

Installation should always be performed by a licensed operator. It is the responsibility of the installer to check that both the pipe(s) and fitting(s) that are installed are compatible, only compatible materials should be joined together. It is the responsibility of the licensed installer to check the PN and PSI ratings marked on the fitting(s) and ensure that the pipe is compatible. Correct installation procedures should always be followed.

The drawings, materials and specifications outlined are subject to change without notice due to the continuous improvements and development of our product range.

FUSION QLD PTY LTD

ABN: 42 987 067 369
13 Vision Court, Noosaville, QLD, 4566
42-44 South Link, Dandenong, VIC, 3175

CONTACT

T: +61 7 5474 3000 (Qld)
T: +61 3 9037 4755 (Vic)
E: sales@fusionqld.com.au
W: fusionqld.com.au